


BOUQUET CIRCUIT PLAN

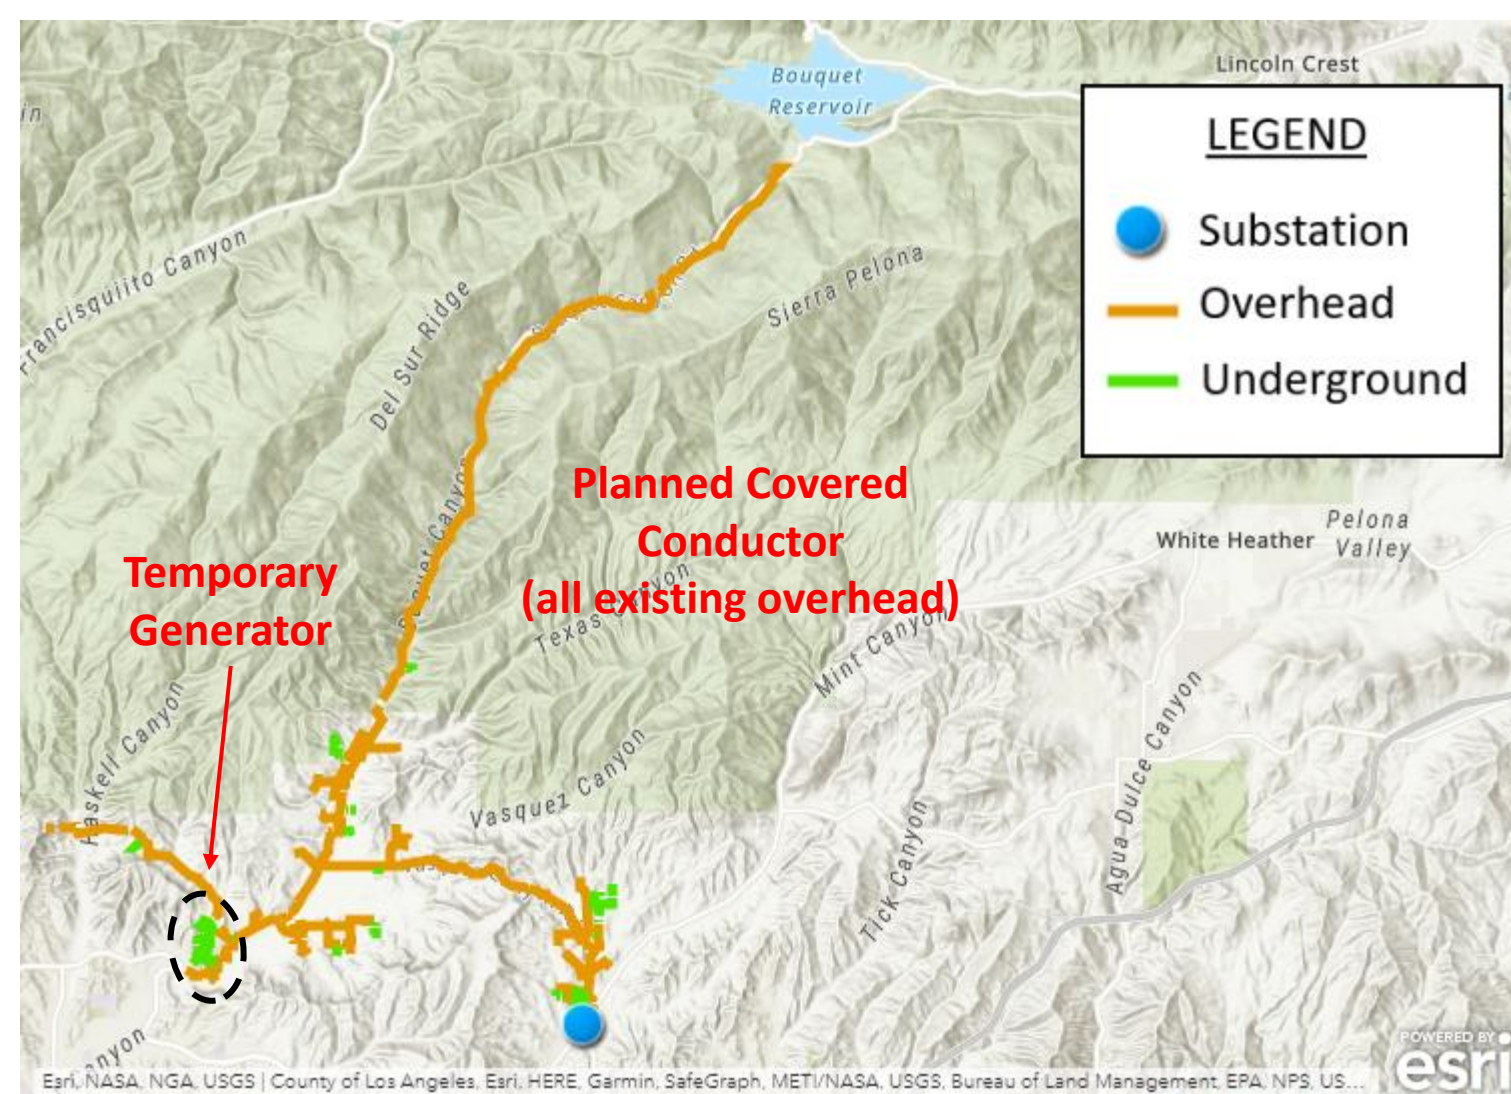

Planned Work:

- Replace 28.9 miles of existing overhead wire with new covered conductor
- Add temporary generator to serve approx. 250 customers during a PSPS event with minimal outages

Expected Improvements:

- Work delayed until 2022 due to the complexity of the construction work
- While this circuit did not experience a PSPS event in 2020, this planned work is expected to reduce the impact of PSPS in the future