

PUBLIC UTILITIES COMMISSION

SAN FRANCISCO, CA 94102-3298



September 17, 2009

Advice Letter 2371-E

Akbar Jazayeri
Vice President, Regulatory Operations
Southern California Edison Company
P O Box 800
Rosemead, CA 91770

**Subject: Notice of Proposed Construction Project Pursuant to
General Order 131-D, Sanderson Avenue Widening
Project 115 kV Line Relocation**

Dear Mr. Jazayeri:

Advice Letter 2371-E is effective September 4, 2009.

Sincerely,

A handwritten signature in blue ink that reads "Julie A. Fitch".

Julie A. Fitch, Director
Energy Division

August 5, 2009

ADVICE 2371-E
(U 338-E)

PUBLIC UTILITIES COMMISSION OF THE STATE OF CALIFORNIA
ENERGY DIVISION

SUBJECT: Notice of Proposed Construction Project Pursuant to
General Order 131-D, Sanderson Avenue Widening Project
115 kV Line Relocation

Southern California Edison Company (SCE) hereby submits notice pursuant to General Order 131-D (GO 131-D), Section XI, Subsection B.4 of the Construction of Facilities that are exempt from a Permit to Construct. GO 131-D was adopted by the California Public Utilities Commission (Commission) in Decision (D.)94-06-014 and modified by D.95-08-038.

PURPOSE

This advice filing provides a copy of the Notice of Proposed Construction (Attachment A) and the Notice Distribution List (Attachment B) which comply with the noticing requirements found in GO 131-D, Section XI, Subsections B and C.

BACKGROUND

SCE is proposing to relocate a portion of its Valley-Mayberry-Moreno-Vista 115 kilovolt (kV) subtransmission line in order to accommodate the City of San Jacinto's Sanderson Avenue Widening Project. The SCE subtransmission line to be relocated to accomplish the street widening project is approximately 2.5 miles in length, and extends from the intersection of Ramona Expressway and Sanderson Avenue south to Cottonwood Avenue, and east on Cottonwood to San Remo Avenue in the City of San Jacinto (please refer to the enclosed map). This project will involve the relocation of 28 wood subtransmission poles and four (4) wood subtransmission guy stub support poles as follows:

- One (1) 85-foot wood subtransmission pole located on the west side of the intersection of the Ramona Expressway and Sanderson Avenue will be relocated 6 feet further to the west and will be replaced with an 80-foot wood pole;
- Four (4) wood subtransmission guy stub support poles, ranging in height between 40–45 feet, located south of the Ramona Expressway and Sanderson Avenue intersection on the east side of Sanderson Avenue, will be relocated approximately

33 feet further to the east and replaced with four (4) 45-foot wood subtransmission guy stub support poles;

- 23 wood subtransmission poles on the west side of Sanderson Avenue, each of which are approximately 70 feet in height, will be relocated to the east side of Sanderson Avenue and replaced with new wood subtransmission poles ranging in height between 70–75 feet; and
- Four (4) 70-foot wood poles on the north side of Cottonwood Avenue east of Sanderson Avenue will be relocated approximately 15–20 feet north of the existing pole locations and replaced with four (4) new wood subtransmission poles ranging in height between 70–75 feet.

The existing subtransmission poles are strung with 653 Aluminum Conductor Steel Reinforced (ACSR); the relocated subtransmission poles will be strung with the same size conductor.

Pursuant to Commission GO 131-D, Section III.B.1, projects meeting specific conditions are exempt from the Commission's requirement to file for an application requesting authority to construct. This project qualifies for the following exemption:

- “f: power lines or substations to be relocated or constructed which have undergone environmental review pursuant to CEQA as part of a larger project, and for which the final CEQA document [Environmental Impact Report (EIR) or Negative Declaration] finds no significant unavoidable environmental impacts caused by the proposed line or substation.”

On May 15, 2008, the City of San Jacinto City Council approved the Initial Study and Mitigated Negative Declaration for the proposed Sanderson Avenue Widening Project (SCH # 2008021044), including the proposed relocation of the existing SCE subtransmission line, pursuant to the California Environmental Quality Act (CEQA) and found that the proposed project causes no significant unavoidable environmental impacts.

GO 131-D, Section XI, Subsection B.4, requires that this advice filing be made not less than 30 days before the date such construction is intended to begin. Construction of the proposed project is scheduled to begin on or after September 21, 2009, and be completed by February 2010.

No cost information is required for this advice filing.

This advice filing will not increase any rate or charge, cause the withdrawal of service, or conflict with any other rate schedule or rule.

EFFECTIVE DATE

Because this filing is being made in accordance with the noticing requirements described in GO 131-D, Section XI, Subsection B.4, this advice filing will become effective on September 4, 2009, the 30th calendar day after the date filed.

NOTICE

Anyone wishing to protest this advice filing may do so by letter via U.S. Mail, facsimile, or electronically, any of which must be received no later than August 25, 2009, which is 20 days after the date of this advice filing. Protests should be mailed to:

CPUC, Energy Division
Attention: Tariff Unit
505 Van Ness Avenue
San Francisco, California 94102
E-mail: inj@cpuc.ca.gov and mas@cpuc.ca.gov

Copies should also be mailed to the attention of the Director, Energy Division, Room 4004 (same address above).

In addition, protests and all other correspondence regarding this advice letter should also be sent by letter and transmitted via facsimile or electronically to the attention of:

Akbar Jazayeri
Vice President of Regulatory Operations
Southern California Edison Company
2244 Walnut Grove Avenue
Rosemead, California 91770
Facsimile: (626) 302-4829
E-mail: AdviceTariffManager@sce.com

Bruce Foster
Senior Vice President, Regulatory Affairs
c/o Karyn Gansecki
Southern California Edison Company
601 Van Ness Avenue, Suite 2040
San Francisco, California 94102
Facsimile: (415) 929-5540
E-mail: Karyn.Gansecki@sce.com

There are no restrictions on who may file a protest, but the protest shall set forth specifically the grounds upon which it is based and shall be submitted expeditiously.

In accordance with Section 4 of GO 96-B, SCE is serving copies of this advice filing to the interested parties shown on the attached GO 96-B service list. Address change requests to the GO 96-B service list should be directed by electronic mail to AdviceTariffManager@sce.com or at (626) 302-2930. For changes to all other service lists, please contact the Commission's Process Office at (415) 703-2021 or by electronic mail at Process_Office@cpuc.ca.gov.

Further, in accordance with Public Utilities Code Section 491, notice to the public is hereby given by filing and keeping the advice filing at SCE's corporate headquarters. To view other

SCE advice letters filed with the Commission, log on to SCE's web site at <http://www.sce.com/AboutSCE/Regulatory/adviceletters>.

For questions, please contact Christine McLeod at (626) 302-3947 or by electronic mail at Christine.Mcleod@sce.com.

Southern California Edison Company

Akbar Jazayeri

AJ:sq
Enclosures

CALIFORNIA PUBLIC UTILITIES COMMISSION

ADVICE LETTER FILING SUMMARY ENERGY UTILITY

MUST BE COMPLETED BY UTILITY (Attach additional pages as needed)

Company name/CPUC Utility No.: Southern California Edison Company (U 338-E)

Utility type:

ELC GAS
 PLC HEAT WATER

Contact Person: James Yee

Phone #: (626) 302-2509

E-mail: James.Yee@sce.com

E-mail Disposition Notice to: AdviceTariffManager@sce.com

EXPLANATION OF UTILITY TYPE

ELC = Electric GAS = Gas
 PLC = Pipeline HEAT = Heat WATER = Water

(Date Filed/ Received Stamp by CPUC)

Advice Letter (AL) #: 2371-E

Tier Designation: N/A

Subject of AL: Notice of Proposed Construction Project Pursuant to General Order 131-D, Sanderson Avenue Widening Project 115 kV Line Relocation

Keywords (choose from CPUC listing): Compliance, Power Lines

AL filing type: Monthly Quarterly Annual One-Time Other

If AL filed in compliance with a Commission order, indicate relevant Decision/Resolution #:

D.94-06-014 and D.95-08-038

Does AL replace a withdrawn or rejected AL? If so, identify the prior AL: _____

Summarize differences between the AL and the prior withdrawn or rejected AL¹: _____

Confidential treatment requested? Yes No

If yes, specification of confidential information:

Confidential information will be made available to appropriate parties who execute a nondisclosure agreement.

Name and contact information to request nondisclosure agreement/access to confidential information:

Resolution Required? Yes No

Requested effective date: 9/4/09 No. of tariff sheets: -0-

Estimated system annual revenue effect: (%): _____

Estimated system average rate effect (%): _____

When rates are affected by AL, include attachment in AL showing average rate effects on customer classes (residential, small commercial, large C/I, agricultural, lighting).

Tariff schedules affected: None

Service affected and changes proposed¹: _____

Pending advice letters that revise the same tariff sheets: _____

¹ Discuss in AL if more space is needed.

Protests and all other correspondence regarding this AL are due no later than August 25, 2009, which is 20 days after the date of this filing, unless otherwise authorized by the Commission, and shall be sent to:

CPUC, Energy Division
Attention: Tariff Unit
505 Van Ness Ave.,
San Francisco, CA 94102
inj@cpuc.ca.gov and mas@cpuc.ca.gov

Akbar Jazayeri
Vice President of Regulatory Operations
Southern California Edison Company
2244 Walnut Grove Avenue
Rosemead, California 91770
Facsimile: (626) 302-4829
E-mail: AdviceTariffManager@sce.com

Bruce Foster
Senior Vice President, Regulatory Affairs
c/o Karyn Gansecki
Southern California Edison Company
601 Van Ness Avenue, Suite 2040
San Francisco, California 94102
Facsimile: (415) 929-5540
E-mail: Karyn.Gansecki@sce.com

Attachment A

NOTICE OF PROPOSED CONSTRUCTION

SANDERSON AVENUE WIDENING PROJECT 115 KV LINE RELOCATION

SCE Advice Letter Number: 2371-E

Date: August 5, 2009

Proposed Project:

Southern California Edison Company (SCE) is proposing to relocate a portion of its Valley-Mayberry-Moreno-Vista 115 kilovolt (kV) subtransmission line in order to accommodate the City of San Jacinto's Sanderson Avenue Widening Project. The SCE subtransmission line to be relocated to accomplish the street widening project is approximately 2.5 miles in length, and extends from the intersection of Ramona Expressway and Sanderson Avenue south to Cottonwood Avenue, and east on Cottonwood to San Remo Avenue in the City of San Jacinto (please refer to the enclosed map). This project will involve the relocation of 28 wood subtransmission poles and four (4) wood subtransmission guy stub support poles as follows:

- One (1) 85-foot wood subtransmission pole located on the west side of the intersection of the Ramona Expressway and Sanderson Avenue will be relocated 6 feet further to the west and will be replaced with an 80-foot wood pole;
- Four (4) wood subtransmission guy stub support poles, ranging in height between 40–45 feet, located south of the Ramona Expressway and Sanderson Avenue intersection on the east side of Sanderson Avenue will be relocated approximately 33 feet further to the east and replaced with four (4) 45-foot wood subtransmission guy stub support poles;
- 23 wood subtransmission poles on the west side of Sanderson Avenue, each of which are approximately 70 feet in height, will be relocated to the east side Sanderson Avenue and replaced with new wood subtransmission poles ranging in height between 70–75 feet; and
- Four (4) 70-foot wood poles on the north side of Cottonwood Avenue east of Sanderson Avenue will be relocated approximately 15-20 feet north of the existing pole locations and replaced with four (4) new wood subtransmission poles ranging in height between 70-75 feet.

The existing subtransmission poles are strung with 653 Aluminum Conductor Steel Reinforced (ACSR); the relocated subtransmission poles will be strung with the same size conductor.

Construction of the proposed project is scheduled to begin on or after September 21, 2009, and completed by February 2010.

EMF Compliance: The California Public Utilities Commission (CPUC) requires utilities to employ “no cost” and “low cost” measures to reduce public exposure to electric and magnetic fields (EMF). In accordance with “EMF Design Guidelines” filed with the CPUC in compliance with CPUC Decisions 93-11-013 and 06-01-042, SCE would implement the following measure(s) for this project:

1. Use pole heights that meet or exceed “preferred” 115 kV design criteriaas specified in SCE’s EMF Design Guidelines.
2. Use a compact pole-head configuration that creates lower magnetic fields than other designs.

Exemption from CPUC Authority: Pursuant to CPUC General Order 131-D, Section III.B.1, projects meeting specific conditions are exempt from the CPUC's requirement to file an application requesting authority to construct. This project qualifies for the following exemption:

“f. power lines or substations to be relocated or constructed which have undergone environmental review pursuant to CEQA as part of a larger project, and for which the final CEQA document [Environmental Impact Report (EIR) or Negative Declaration] finds no significant unavoidable environmental impacts caused by the proposed line or substation.”

On May 15, 2008, the City of San Jacinto City Council approved the Initial Study and Mitigated Negative Declaration for the proposed Sanderson Avenue Widening Project (SCH # 2008021044), including the proposed relocation of the existing SCE subtransmission line, pursuant to the California Environmental Quality Act (CEQA) and found that the proposed project causes no significant unavoidable environmental impacts.

Public Review Process: Persons or groups may protest the proposed construction if they believe that the utility has incorrectly applied for an exemption or believe there is a reasonable possibility that the proposed project or cumulative effects or unusual circumstances associated with the project, may adversely impact the environment.

Protests must be filed by August 25, 2009, and should include the following:

1. Your name, mailing address, and daytime telephone number.
2. Reference to the SCE Advice Letter Number and Project Name Identified.
3. A clear description of the reason for the protest.

The letter should also indicate whether you believe that evidentiary hearings are necessary to resolve factual disputes. Protests for this project must be mailed within 20 calendar days to:

California Public Utilities Commission
Director, Energy Division
505 Van Ness Avenue, 4th Floor
San Francisco, CA 94102

AND


Southern California Edison Company
Law Department - Exception Mail
2244 Walnut Grove Avenue
Rosemead, CA 91770
Attention: C. Lawson

SCE must respond within five business days of receipt and serve copies of its response on each protestant and the CPUC. Within 30 days after SCE has submitted its response, the Executive Director of the CPUC will send you a copy of an Executive Resolution granting or denying the request and stating the reasons for the decision.

Assistance in Filing a Protest: For assistance in filing a protest, contact the CPUC's Public Advisor in San Francisco at (415) 703-2074 or in Los Angeles at (213) 576-7057.

Additional Project Information: To obtain further information on the proposed project, please contact:

Ray Hicks
SCE Local Public Affairs Region Manager
Menifee Service Center
26100 Menifee Road
Menifee, CA 92585
Phone: (951) 928-8238

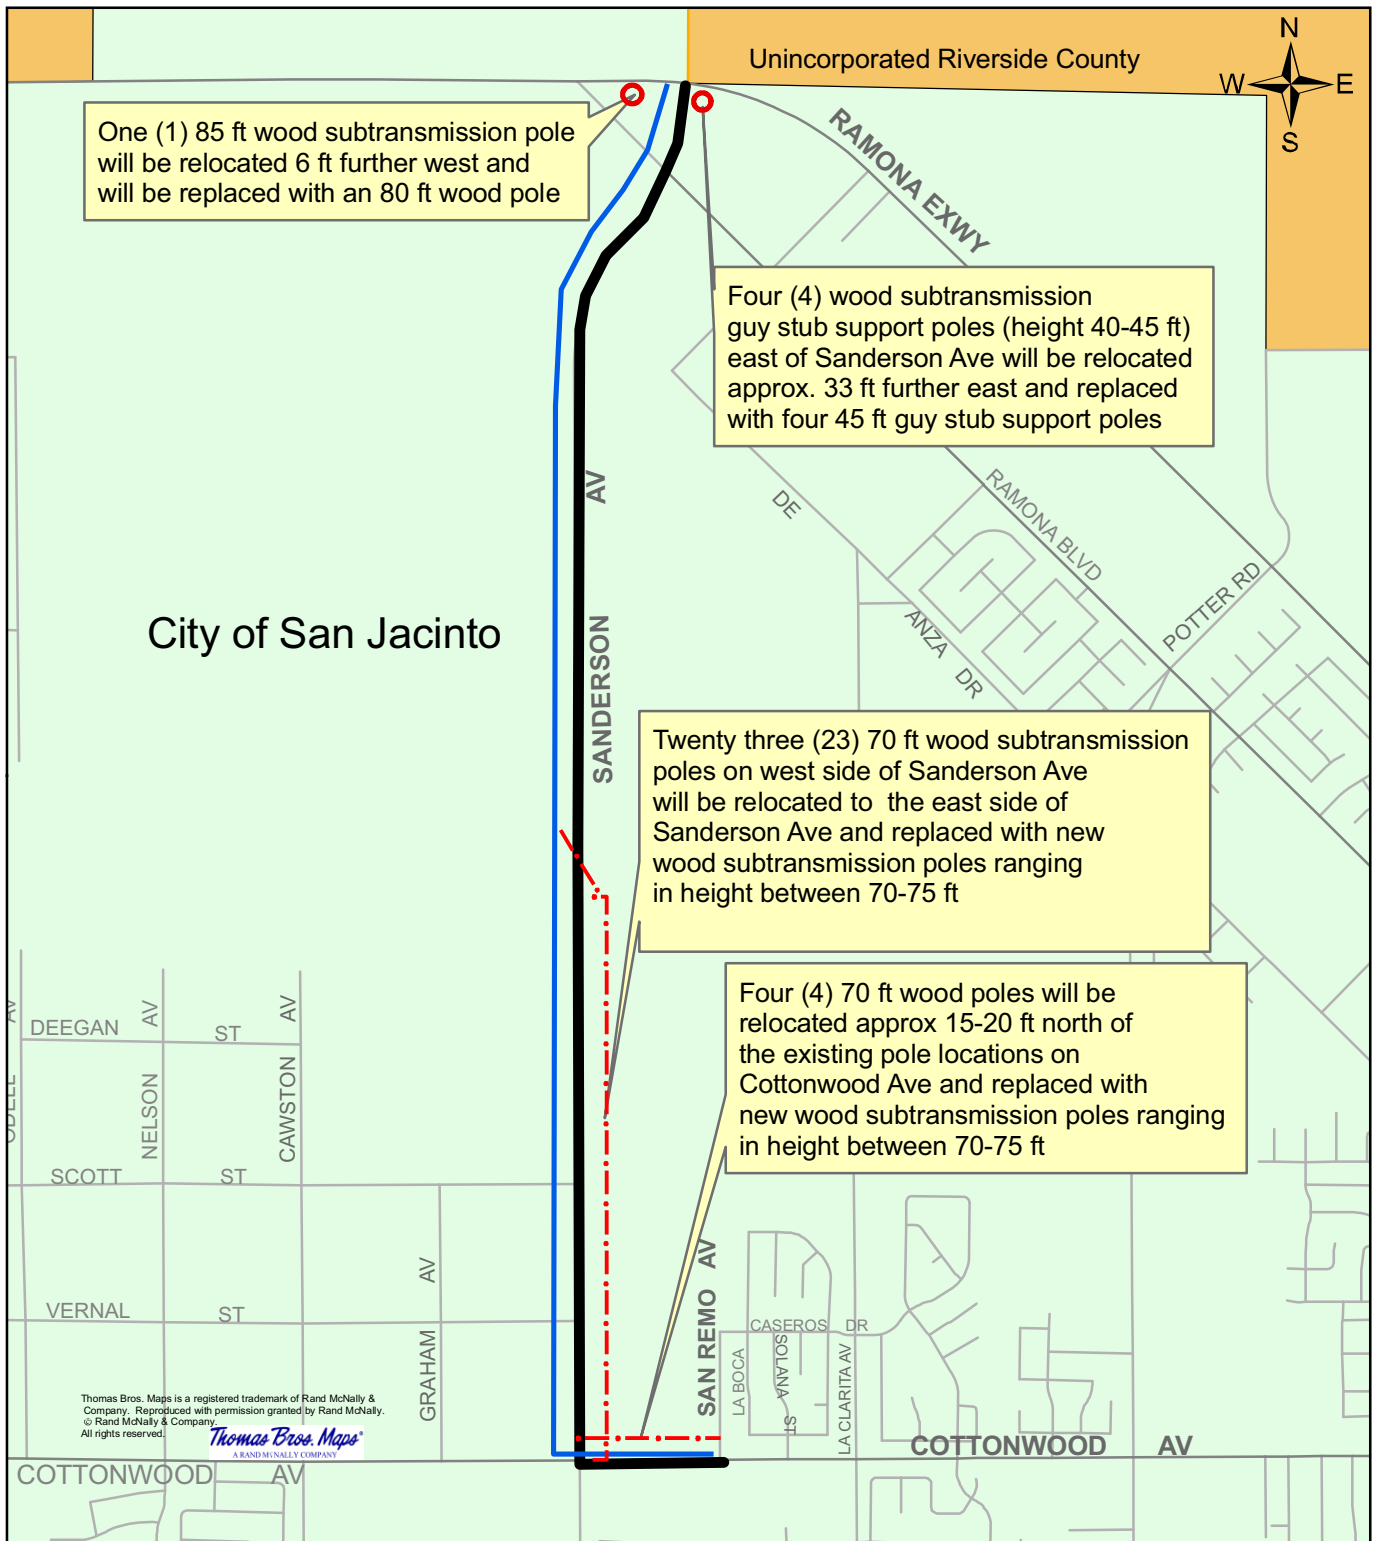


One (1) 85 ft wood subtransmission pole will be relocated 6 ft further west and will be replaced with an 80 ft wood pole

Four (4) wood subtransmission guy stub support poles (height 40-45 ft) east of Sanderson Ave will be relocated approx. 33 ft further east and replaced with four 45 ft guy stub support poles




Twenty three (23) 70 ft wood subtransmission poles on west side of Sanderson Ave will be relocated to the east side of Sanderson Ave and replaced with new wood subtransmission poles ranging in height between 70-75 ft

Four (4) 70 ft wood poles will be relocated approx 15-20 ft north of the existing pole locations on Cottonwood Ave and replaced with new wood subtransmission poles ranging in height between 70-75 ft

Sanderson Avenue Widening Project 115 kV Relocation



Legend

-  Sanderson and Cottonwood Avenues
-  Existing Valley-Mayberry-Moreno-Vista 115 kV Subtransmission Line
-  Relocated line

Attachment B

NOTICE OF DISTRIBUTION LIST Sanderson Avenue Widening Project 115 kV Line Relocation

Distribution List

1) Agencies

Asher Harter
Planning Director
City of San Jacinto
595 So. San Jacinto Avenue
San Jacinto, CA 92583

Melissa Jones
Executive Director
California Energy Commission
1516 9th Street, MS-39
Sacramento, CA 95814-5512

2) Newspapers

Riverside Press Enterprise
3459 Fourteenth Street
Riverside, CA 92501