


Ricardo Circuit Plan

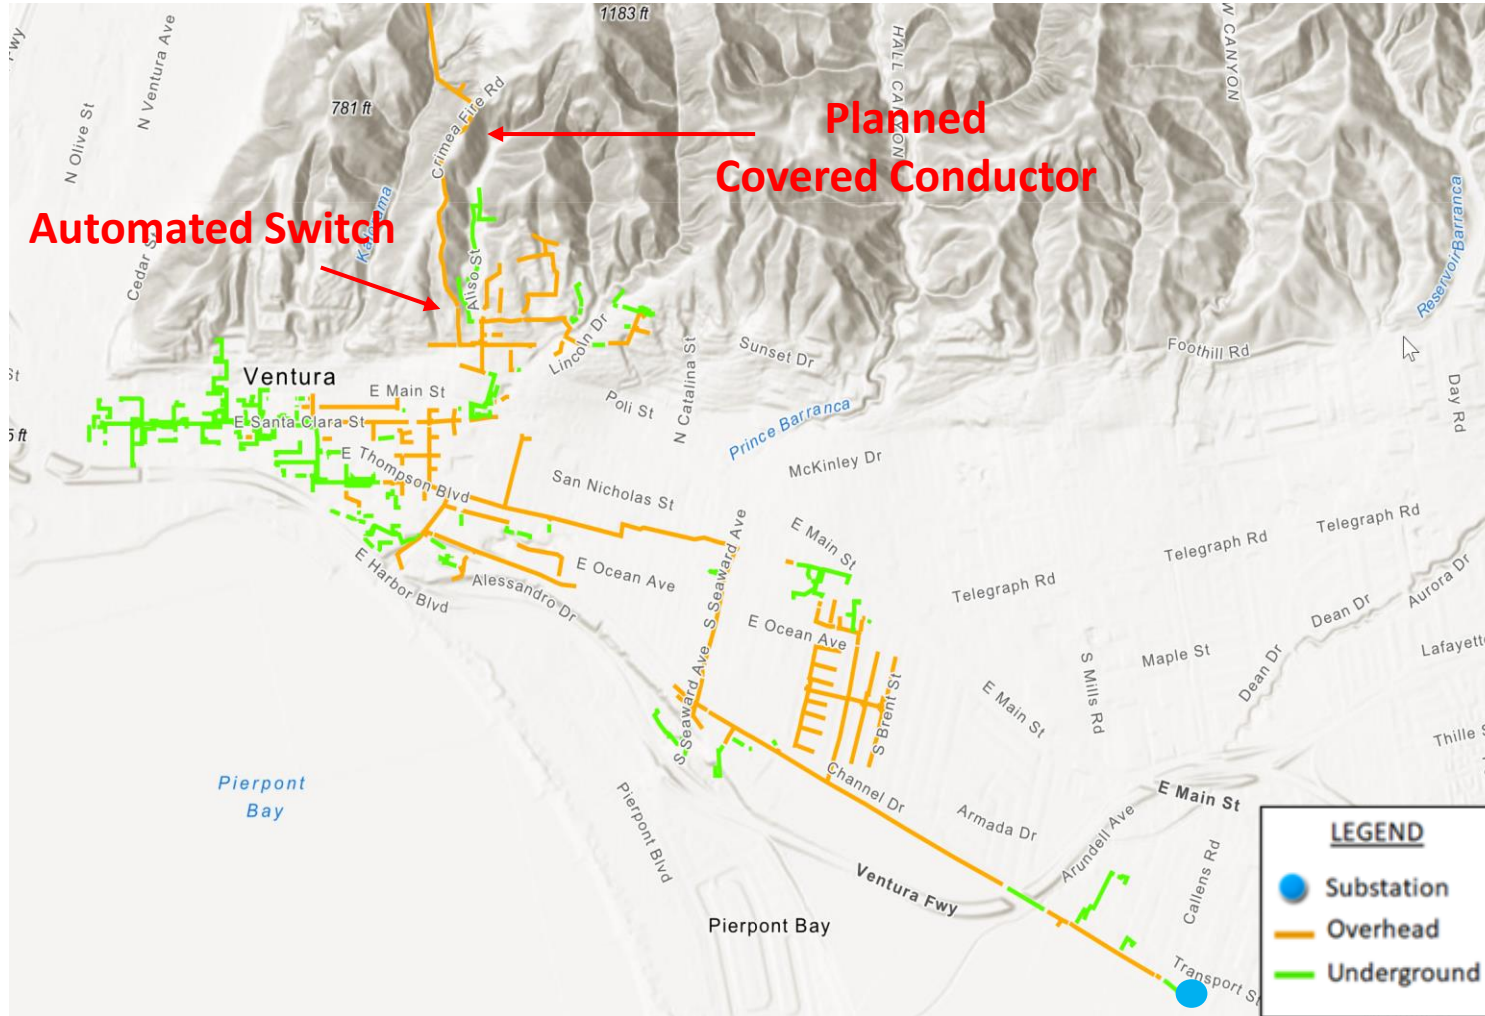

Planned Work:

- Install 1 automated switch and implement additional circuit segmentation
- Replace 0.66 miles of existing overhead wire with new covered conductor

Expected Improvements:

- **96% reduction** in customer outage time, assuming the same weather conditions in 2022