


Tejon Circuit Plan

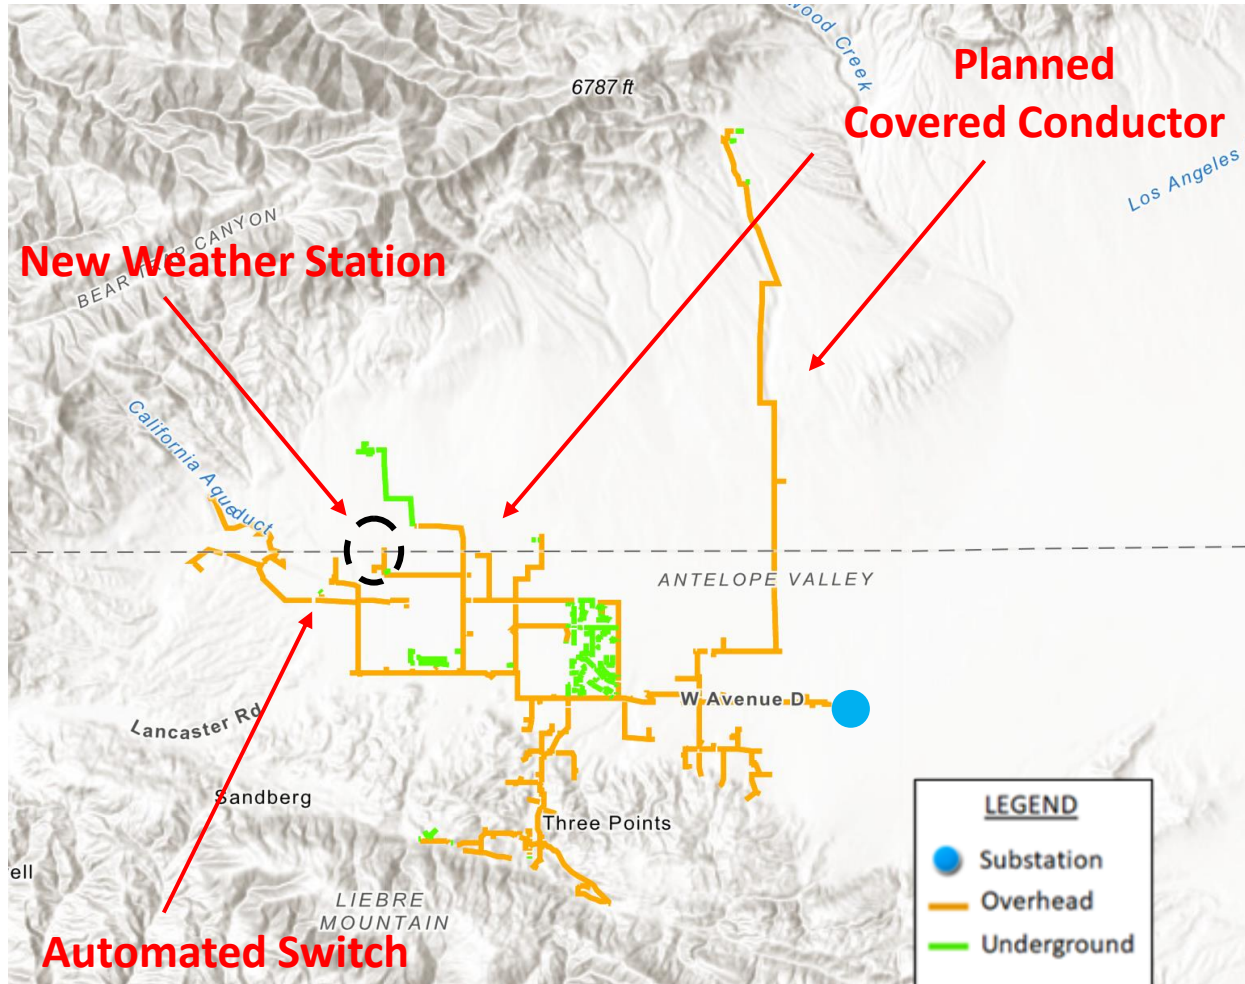

Planned Work:

- Replace 37.77 miles of existing overhead wire with new covered conductor
- Install 1 automated switch and implement additional circuit segmentation
- Install 1 new weather station to improve our situational awareness

Expected Improvements:

- **81% reduction** in customer outage time, assuming the same weather conditions in 2022