


# Accent Circuit Plan

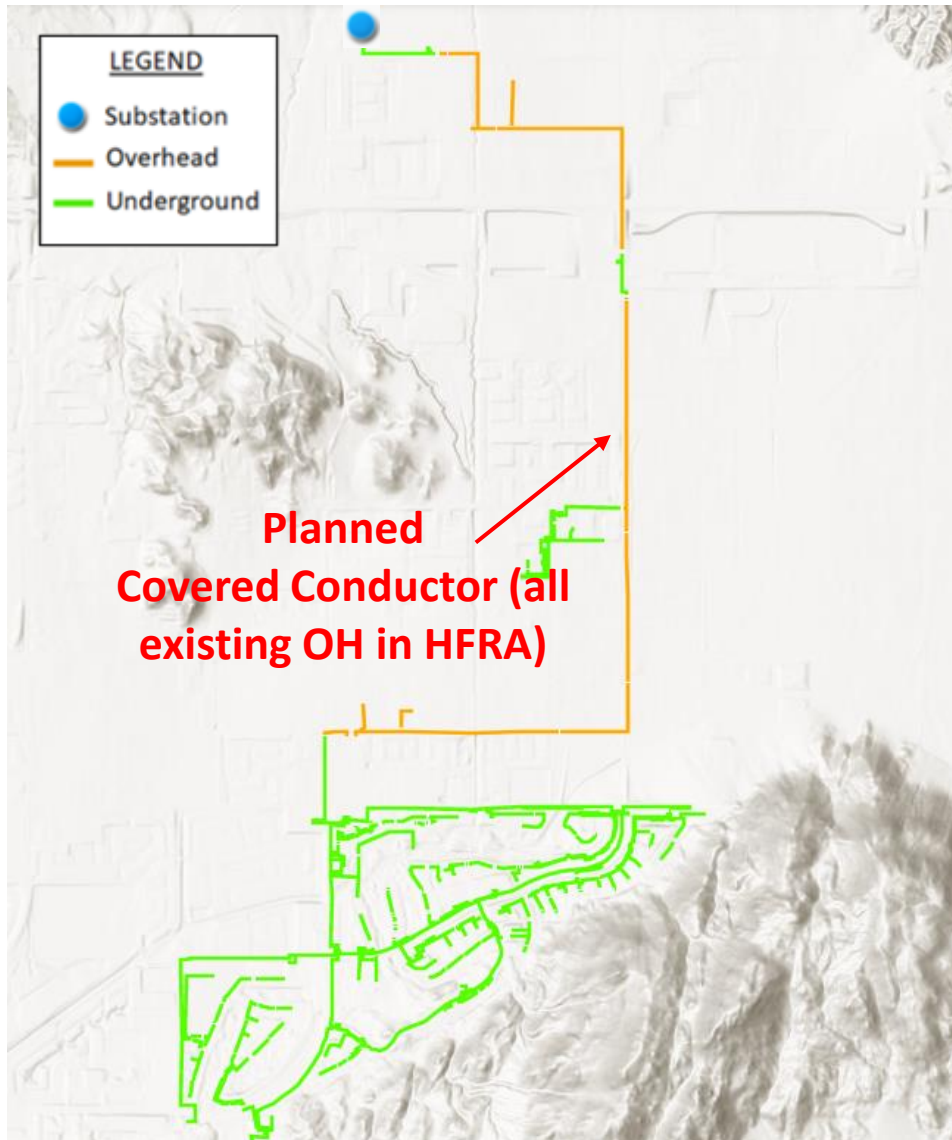

## Planned Work:

- Replace 1.82 miles of existing overhead wire with new covered conductor
- Existing overhead wire in High Fire Risk Area will have covered conductor

## Expected Improvements:

- **100% reduction** in customer outage time, assuming similar weather conditions in 2020 & 2021