


ANTON CIRCUIT PLAN

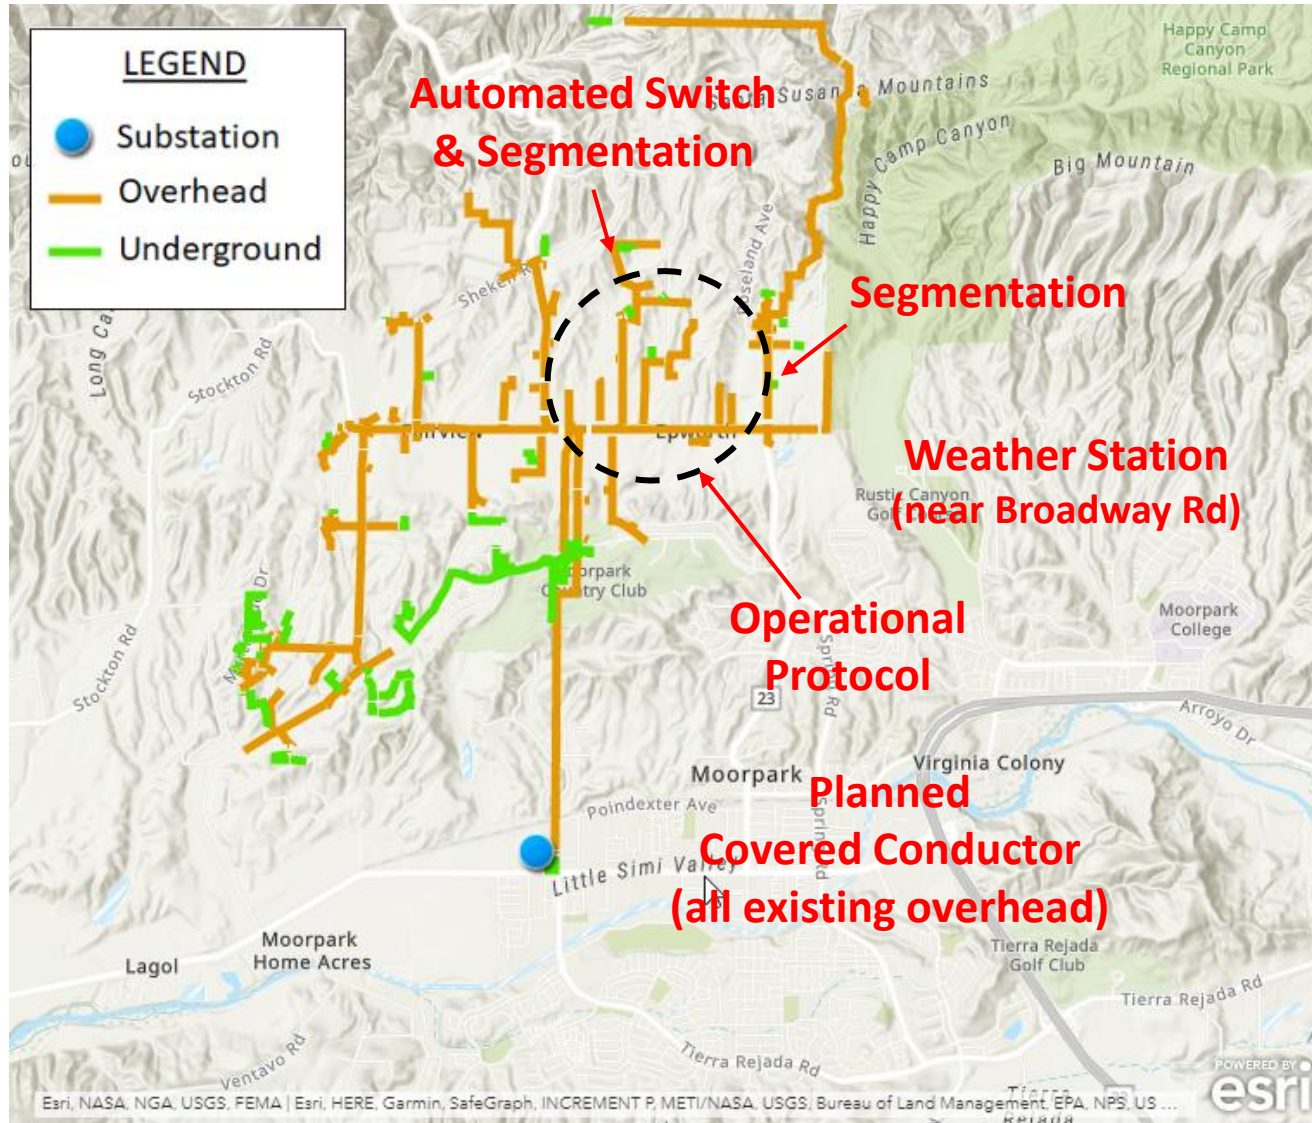

Planned Work:

- Replace 25.2 miles of existing overhead wire with new covered conductor
- Install an additional weather station
- Install 1 automated switch and implement additional segmentation
- Implement operational protocol to raise PSPS windspeed thresholds

Expected Improvements:

- **59% reduction** in customer outage time, assuming the same weather conditions in 2020
- PSPS accelerated work completed; additional grid hardening work taking place through 2022