


# Modjeska Circuit Plan

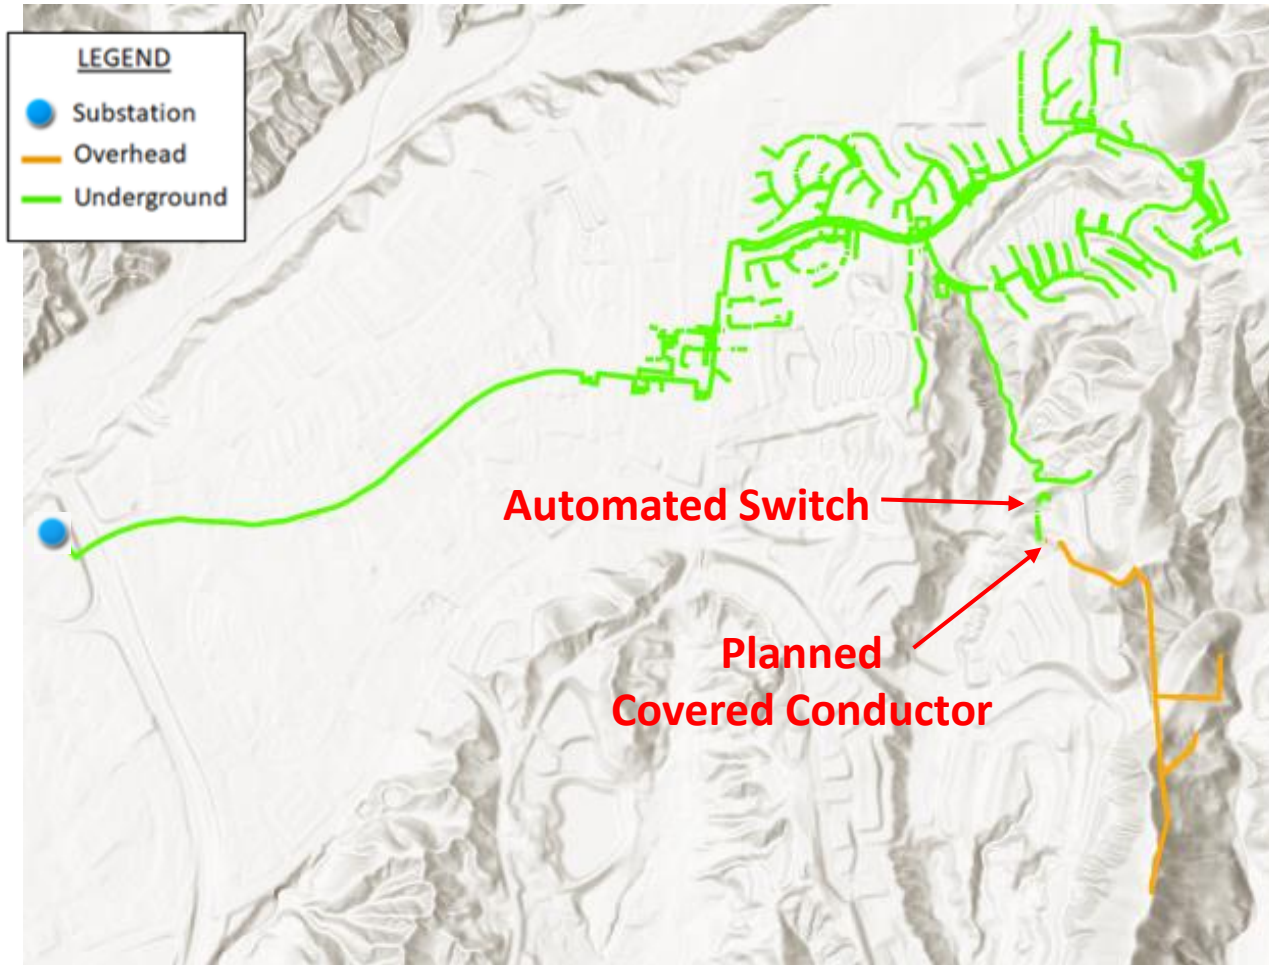

## Planned Work:

- Replace .01 miles of existing overhead wire with new covered conductor
- Install 1 automated switch for additional segmentation

## Expected Improvements:

- **100% reduction** in customer outage time, assuming the same weather conditions in 2020