


Strathern Circuit Plan

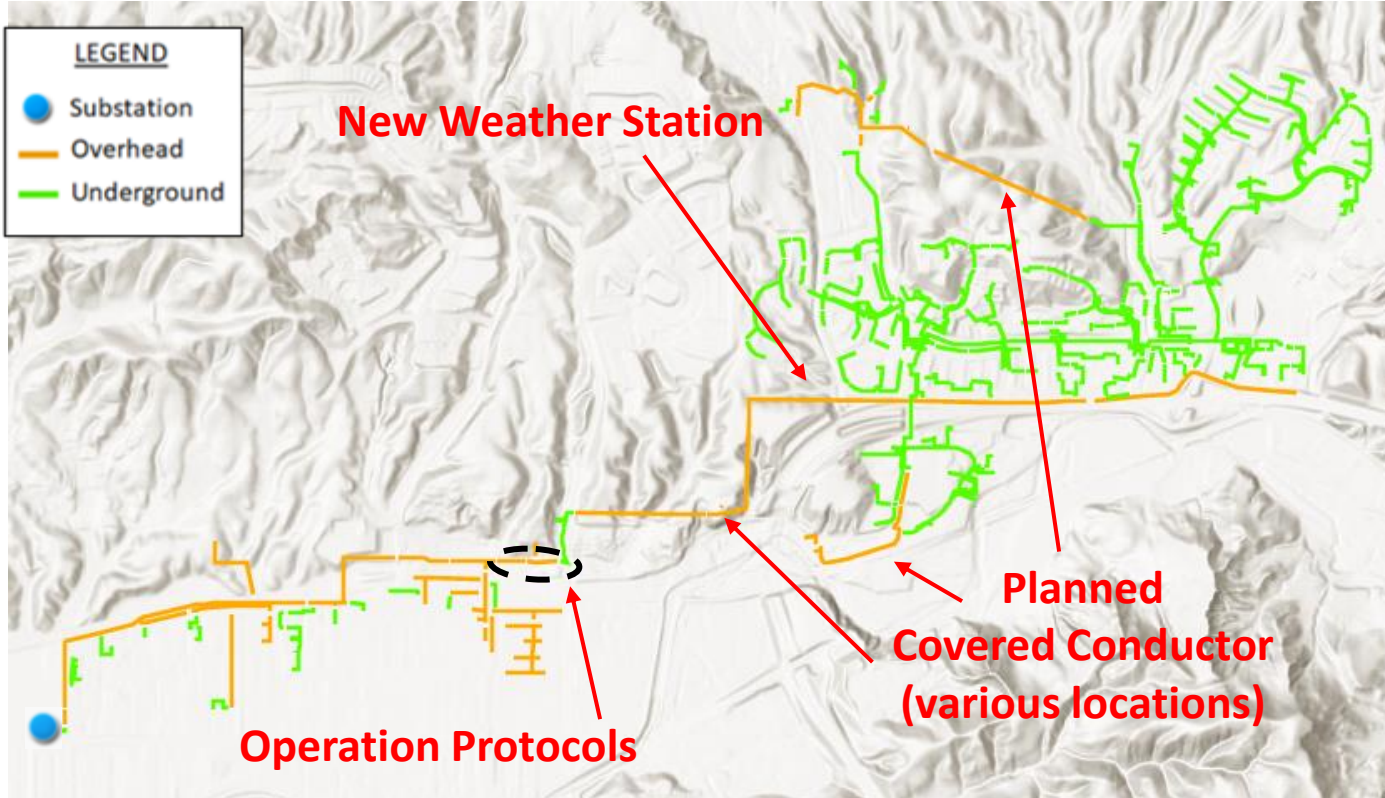

Planned Work:

- Replace 3.3 miles of existing overhead wire with new covered conductor
- Install 1 new weather station
- Implement operational protocol to raise PSPS Thresholds

Expected Improvements:

- **55% reduction** in customer outage time, assuming the same weather conditions in 2020 and 2021