


# ARLENE CIRCUIT PLAN

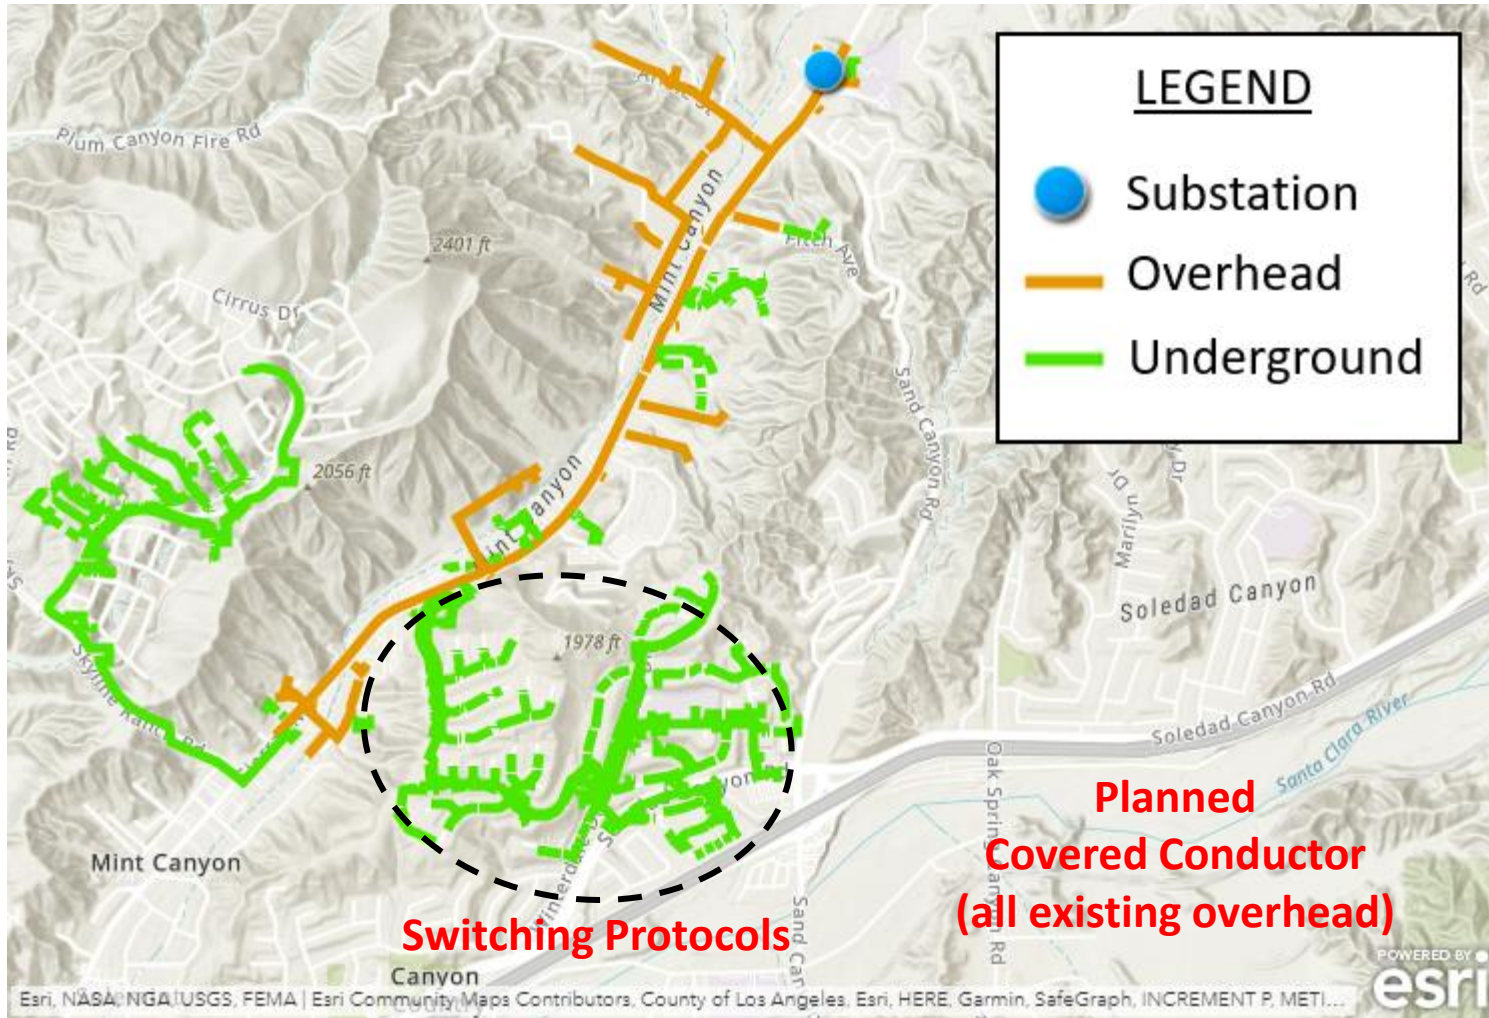

## Planned Work:

- Replace all 7.12 miles of existing overhead wire with new covered conductor
- Switching Protocols

## Expected Improvements:

- **92% reduction** in customer outage time, assuming the same weather conditions in 2020