


DYSART CIRCUIT PLAN

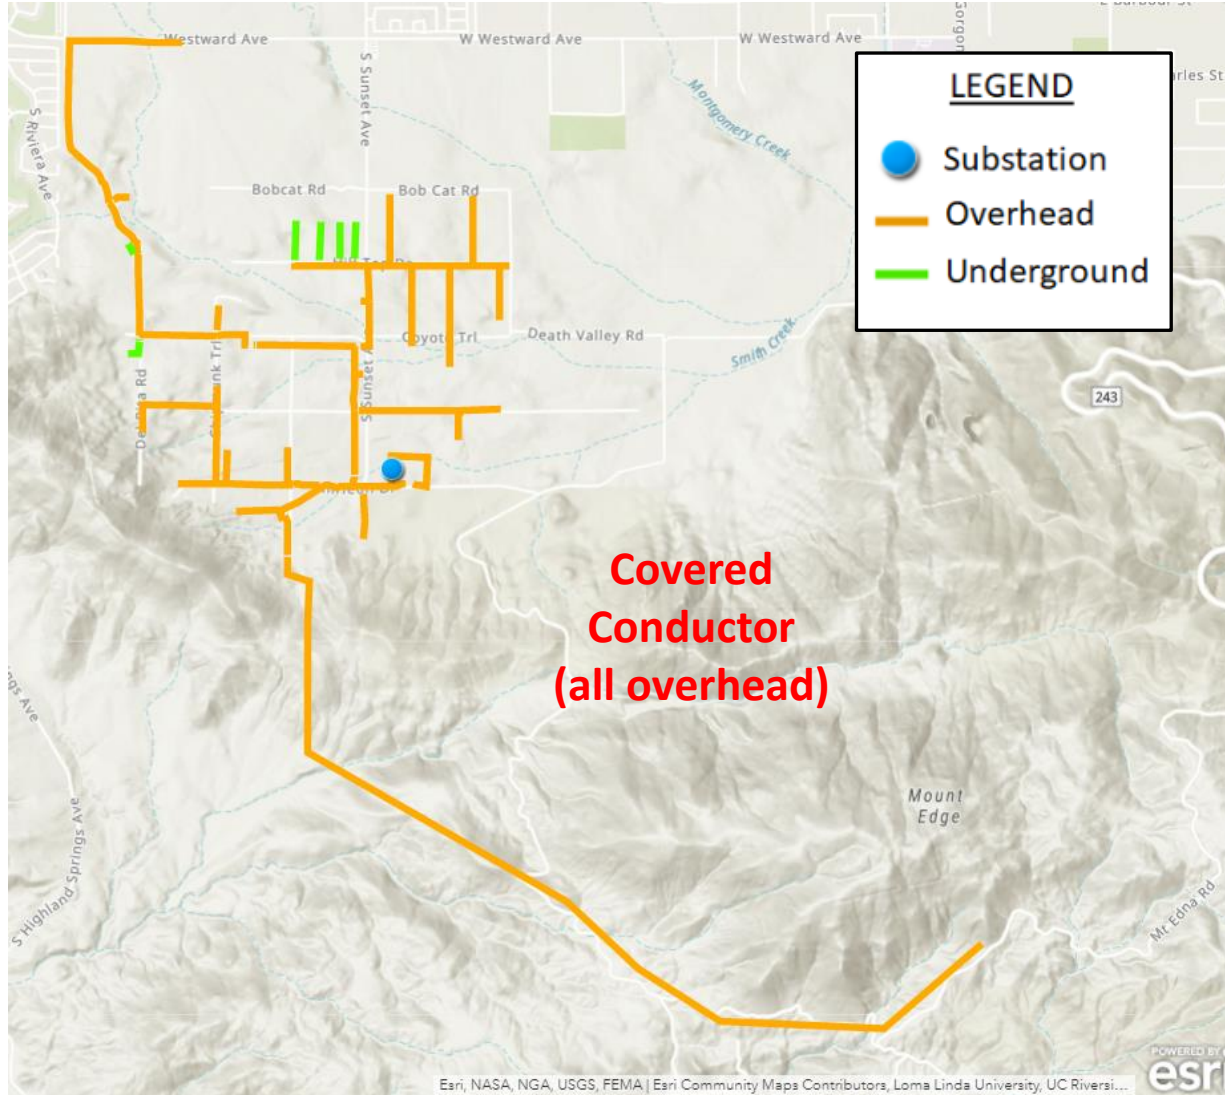

Planned Work:

- Replace 12.9 miles of overhead bare wire with new covered conductor

Expected Improvements:

- **67% reduction** in customer outage time, assuming the same weather conditions in 2020