


FINGAL CIRCUIT PLAN

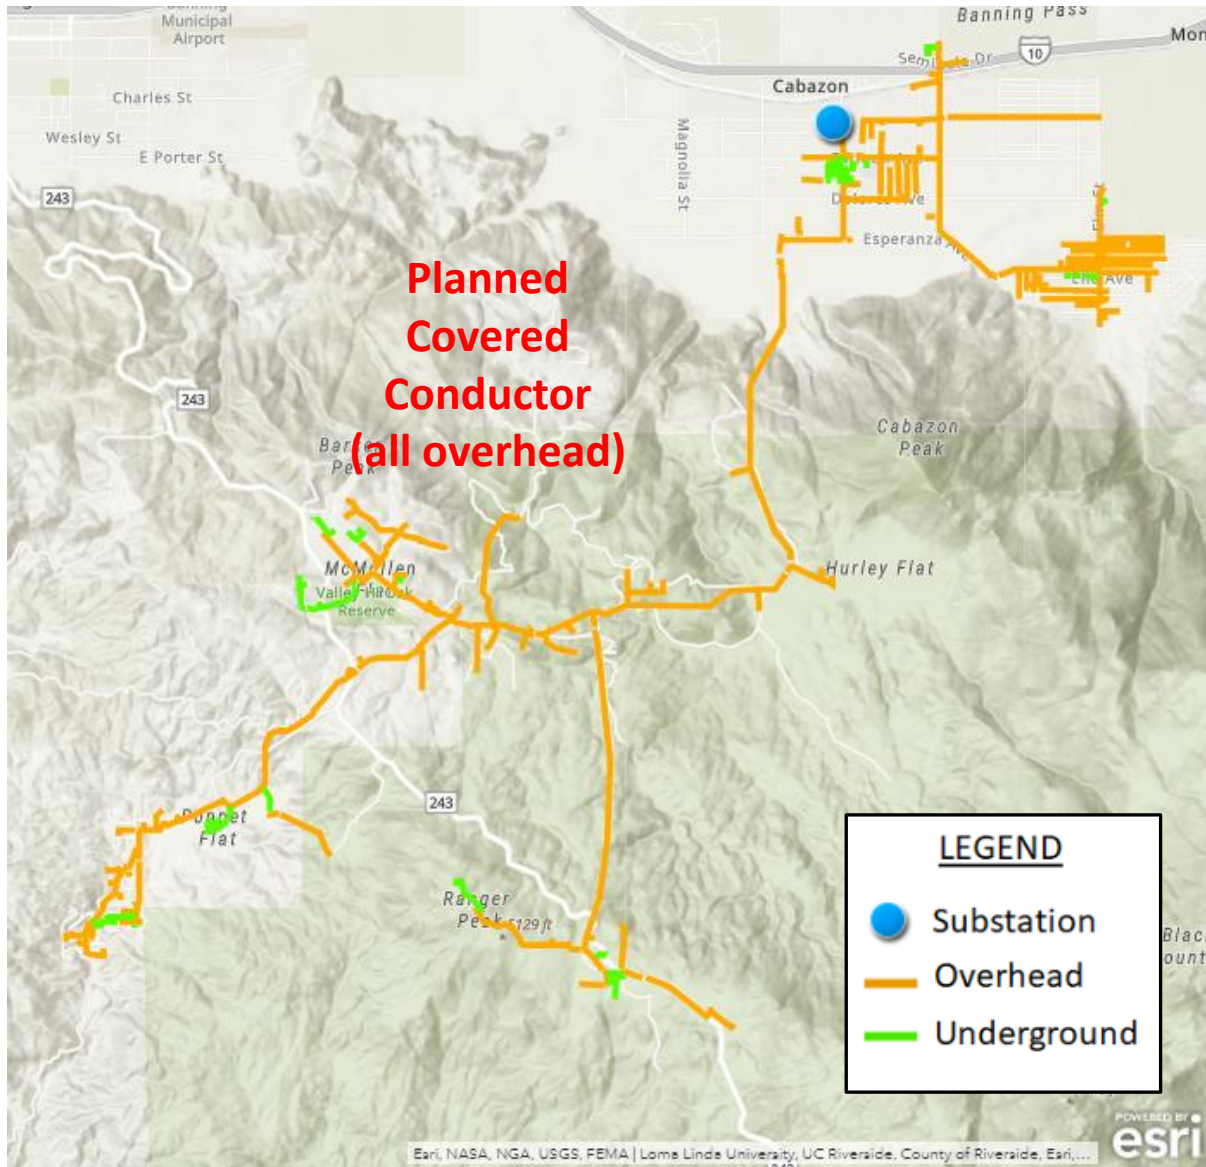

Updated: 09-02-2021

Planned Work:

- Replace approximately 35.1 miles of existing overhead wire with new covered conductor

Expected Improvements:

- **84% reduction** in customer outage time, assuming the same weather conditions in 2020