


# Frozen Circuit Plan

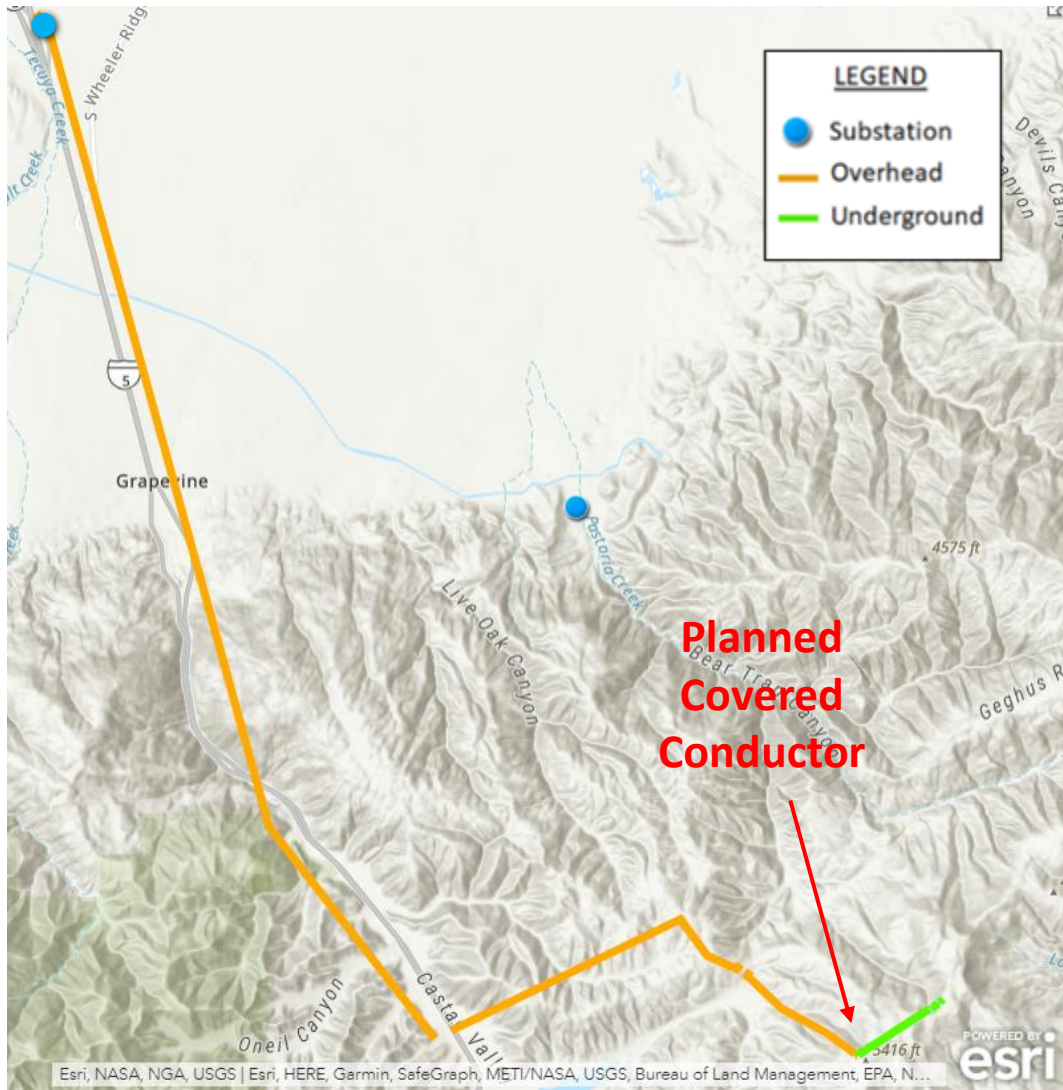

## Planned Work:

- Replace <0.1 miles of existing overhead wire with new covered conductor

## Expected Improvements:

- Unknown at this time – will be assessed based on performance observed in 2021 PSPS season