


Lopez Circuit Plan

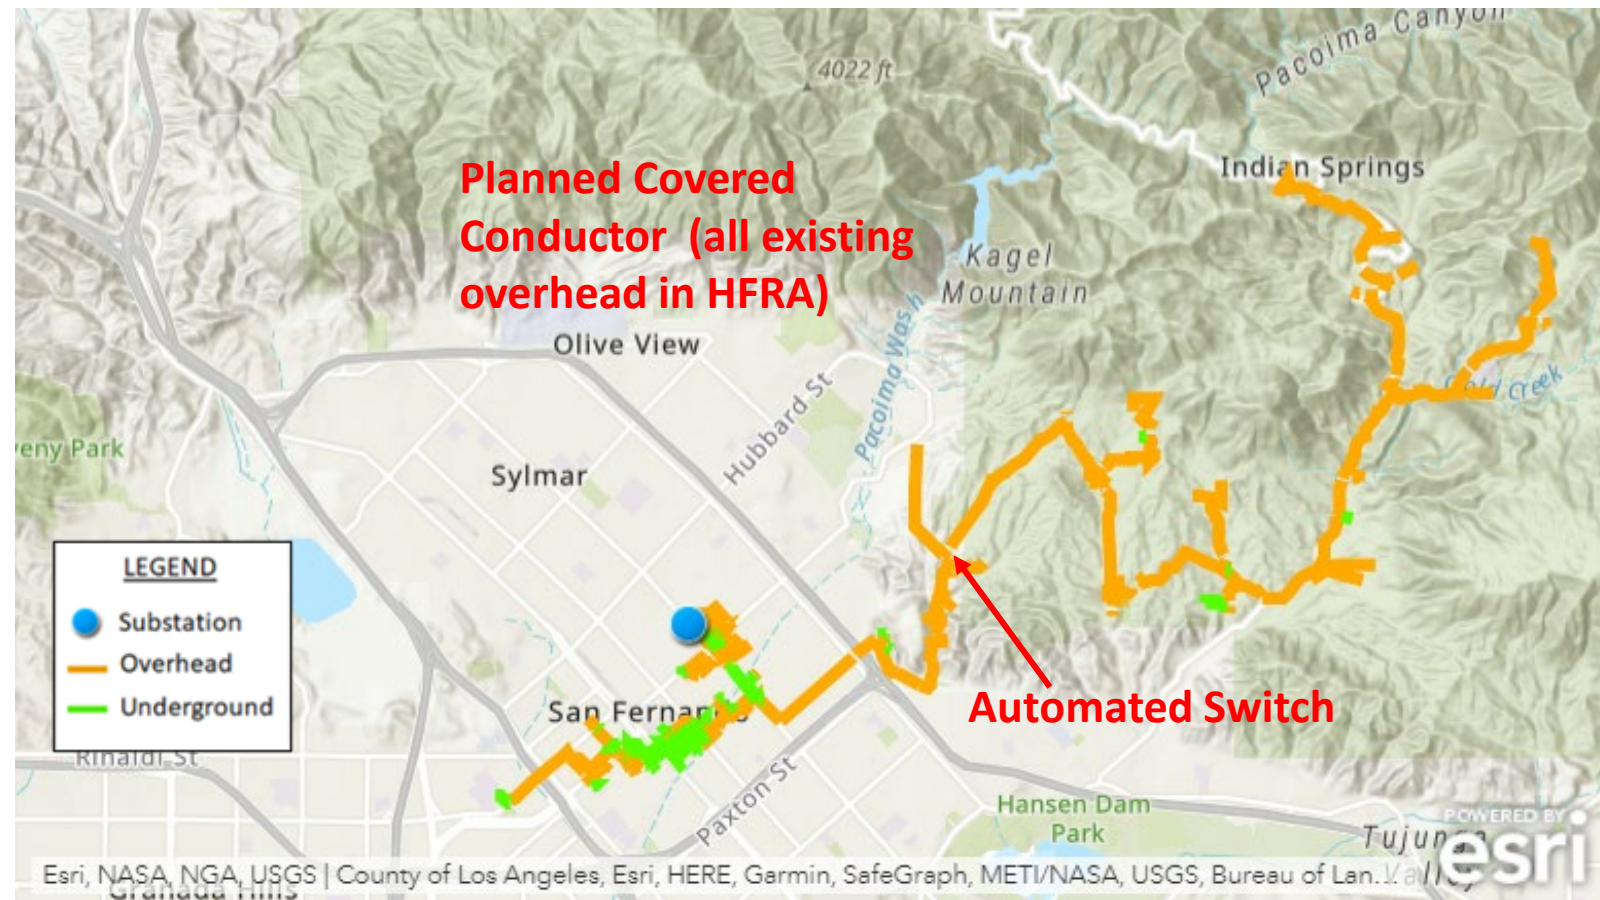

Planned Work:

- Replace 22.4 miles of existing overhead wire with new covered conductor
- Automated Switch: Install a new automated switch

Expected Improvements:

- **100% reduction** in customer outage time, assuming the same weather conditions in 2020