


# NAPA CIRCUIT PLAN

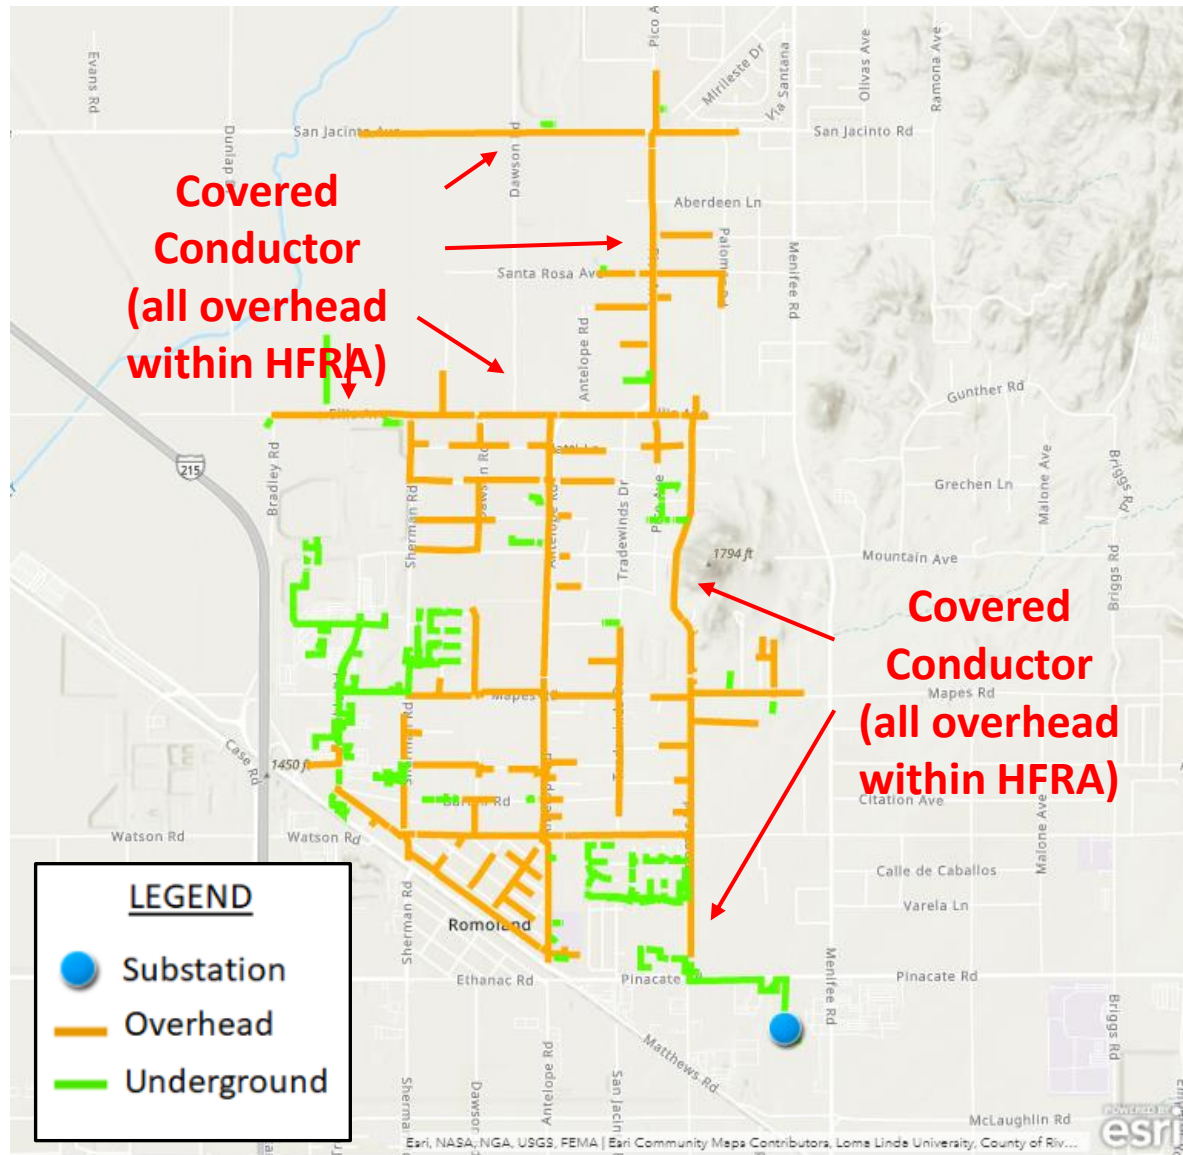

## Planned Work:

- Replace approximately 7.2 miles of existing overhead wire with new covered conductor

## Expected Improvements:

- When the upgrades are completed in 2022, a **100% reduction** in customer outage time is expected assuming the same weather conditions in 2020