


Northpark Circuit Plan

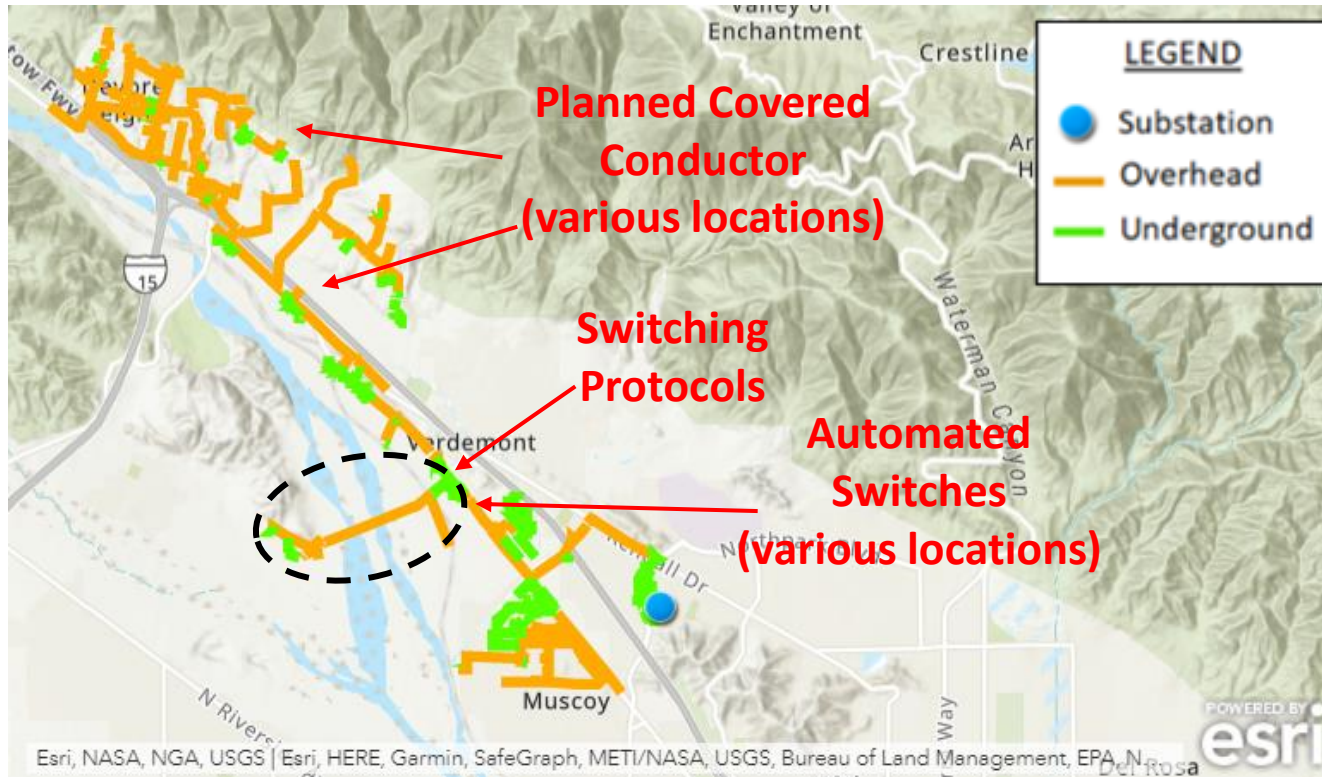

Planned Work:

- Replace 18.6 miles of existing overhead wire with new covered conductor
- Implement switching protocols to transfer load to a less affected circuit
- Automate 2 existing sectionalizing devices

Expected Improvements:

- **100% reduction** in customer outage time, assuming the same weather conditions in 2020