


# PHEASANT CIRCUIT PLAN

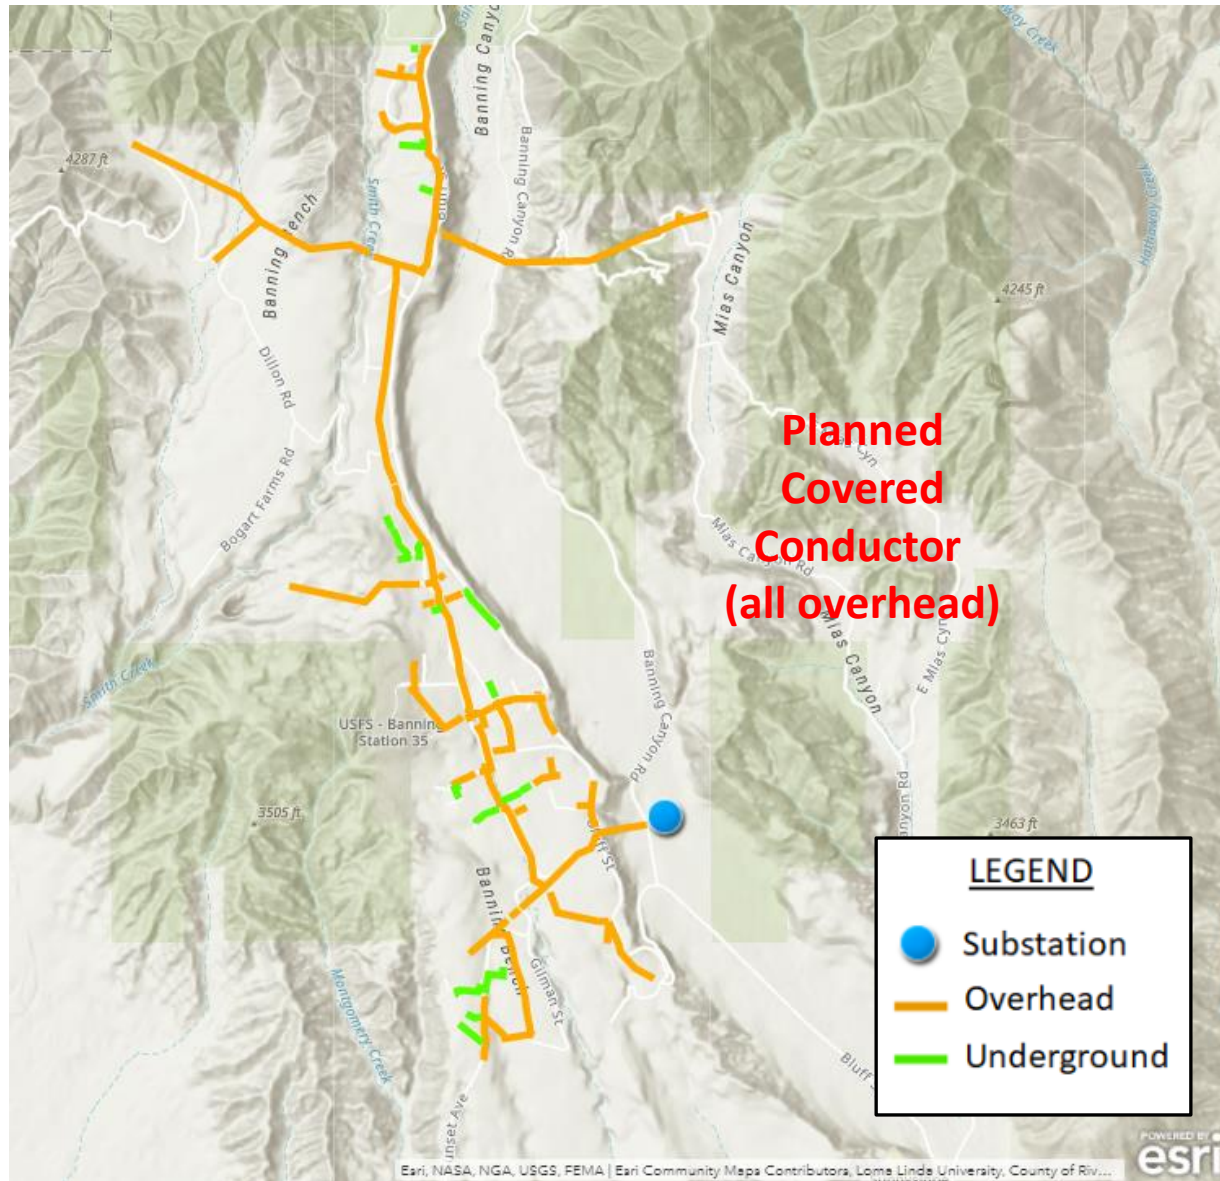

## Planned Work:

- Replace 9.3 miles of existing overhead wire with new covered conductor

## Expected Improvements:

- **100% reduction** in customer outage time, assuming the same weather conditions in 2020